




# LIGHTING SCIENCES CANADA LTD.

440 Phillip St., Unit 19, Waterloo, Ontario, Canada N2L 5R9  
Tel: (519) 746-3140 Fax: (519) 746-3156 lsc@lightingsciences.ca

CERTIFIED TEST REPORT NO. LSC B505  
COMPUTED BY LSC PROGRAM \*\*TEST-LITE\*\*

BEGHELLI 4FT. LUMINAIRE CAT. NO. HZ100 4 HT D1 120V PC REFLECTOR  
WITH PC ALUMINIZED REFLECTOR AND CLEAR WRAP LENS  
ONE F32T8/TL841 32W T8 FLUORESCENT LAMP. LUMEN RATING = 2950 LMS.  
ONE SYLVANIA 120-277V 1 OR 2-LAMP ELECTRONIC BALLAST NO. QTP2x32T8/UNV ISN-SC

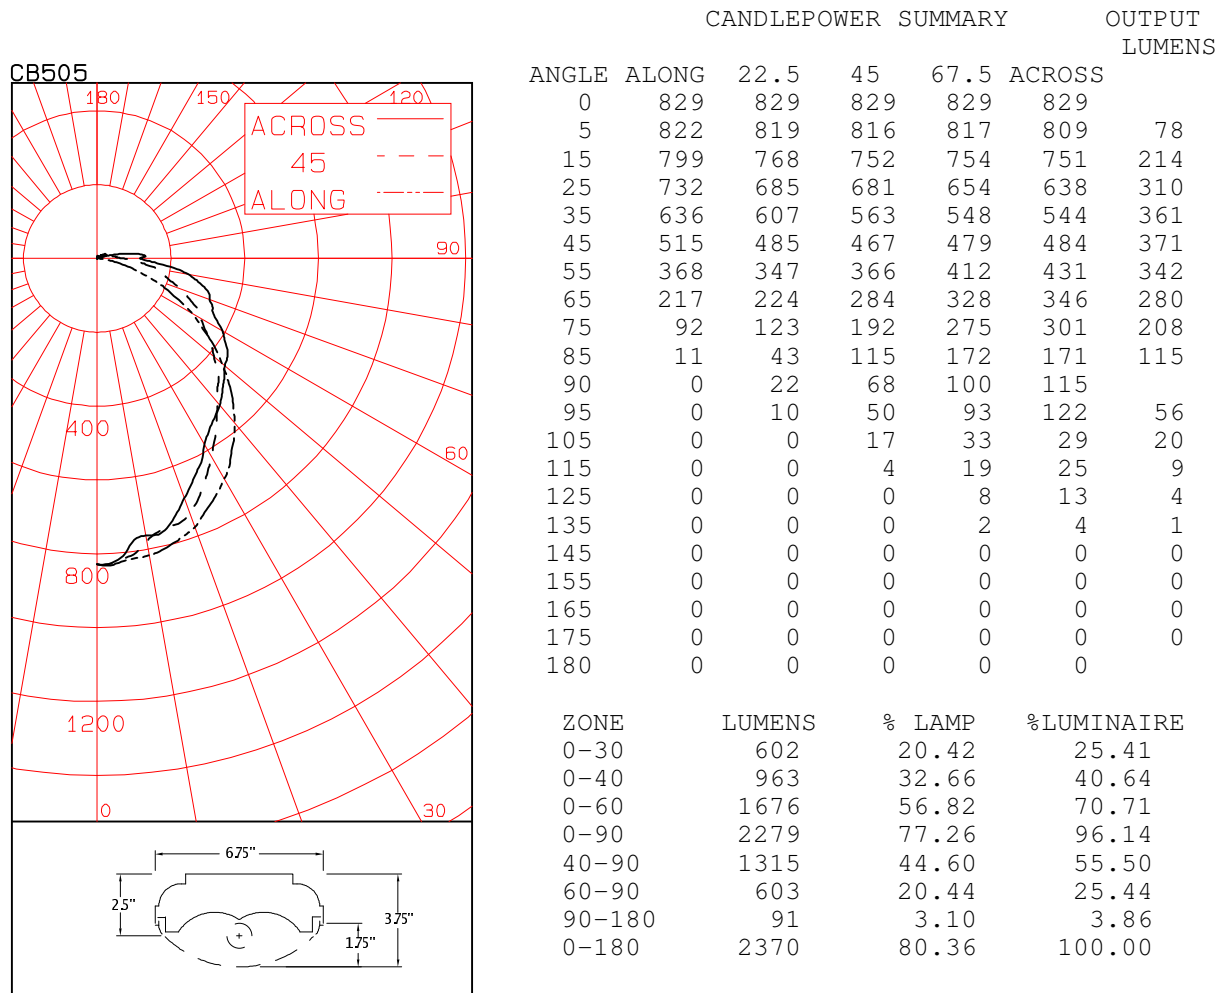

LUMINANCE SUMMARY-CD. / SQ. M.

S/MH = 1.1  
SC (ALONG) = 1.2, SC (ACROSS) = 1.1

ANGLE	ALONG	45	ACROSS
45	3358	2684	2694
55	2910	2438	2751
65	2281	2333	2681
75	1499	2136	3082
85	418	2082	2713

CERTIFIED BY:

*Charles Lison*

DATE:  
DEC 22, 2006

PREPARED FOR:

BEGHELLI NORTH AMERICA  
MIRAMAR, FL, USA

TESTED ACCORDING TO IES PROCEDURES. TEST DISTANCE EXCEEDS FIVE  
TIMES THE GREATEST LUMINOUS OPENING OF LUMINAIRE.

LIGHTING SCIENCES CANADA LTD.  
440 PHILLIP ST., UNIT 19  
WATERLOO, ONTARIO

CERTIFIED TEST REPORT NO. LSC B505  
COMPUTED BY LSC PROGRAM \*\*TEST-LITE\*\*

BEGHELLI 4FT. LUMINAIRE CAT. NO. HZ100 4 HT D1 120V PC REFLECTOR  
WITH PC ALUMINIZED REFLECTOR AND CLEAR WRAP LENS  
ONE F32T8/TL841 32W T8 FLUORESCENT LAMP. LUMEN RATING = 2950 LMS.  
ONE SYLVANIA 120-277V 1 OR 2-LAMP ELECTRONIC BALLAST NO. QTP2x32T8/UNV ISN-SC

CANDLEPOWER DATA

ANGLE	PLANE						OUTPUT LUMENS
	ALONG	22.5	45	67.5	ACROSS	AVERAGE	
0	829	829	829	829	829	829	
5	822	819	816	817	809	817	78
10	817	802	777	767	762	784	
15	799	768	752	754	751	762	214
20	775	716	734	706	692	723	
25	732	685	681	654	638	676	310
30	690	656	619	597	581	627	
35	636	607	563	548	544	577	361
40	581	552	508	516	517	531	
45	515	485	467	479	484	483	371
50	441	410	413	452	452	430	
55	368	347	366	412	431	381	342
60	298	283	324	381	393	334	
65	217	224	284	328	346	280	280
70	147	168	238	300	324	235	
75	92	123	192	275	301	197	208
80	39	82	170	232	251	157	
85	11	43	115	172	171	105	115
90	0	22	68	100	115	62	
95	0	10	50	93	122	54	56
100	0	0	33	81	70	38	
105	0	0	17	33	29	17	20
110	0	0	8	10	25	8	
115	0	0	4	19	25	9	9
120	0	0	0	12	23	6	
125	0	0	0	8	13	4	4
130	0	0	0	3	7	2	
135	0	0	0	2	4	1	1
140	0	0	0	1	0	0	
145	0	0	0	0	0	0	0
150	0	0	0	0	0	0	
155	0	0	0	0	0	0	0
160	0	0	0	0	0	0	
165	0	0	0	0	0	0	0
170	0	0	0	0	0	0	
175	0	0	0	0	0	0	0
180	0	0	0	0	0	0	

LIGHTING SCIENCES CANADA LTD.  
440 PHILLIP ST., UNIT 19  
WATERLOO, ONTARIO

CERTIFIED TEST REPORT NO. LSC B505  
COMPUTED BY LSC PROGRAM \*\*TEST-LITE\*\*

BEGHELLI 4FT. LUMINAIRE CAT. NO. HZ100 4 HT D1 120V PC REFLECTOR  
WITH PC ALUMINIZED REFLECTOR AND CLEAR WRAP LENS  
ONE F32T8/TL841 32W T8 FLUORESCENT LAMP. LUMEN RATING = 2950 LMS.  
ONE SYLVANIA 120-277V 1 OR 2-LAMP ELECTRONIC BALLAST NO. QTP2x32T8/UNV ISN-SC

AVERAGE LUMINANCE DATA

ANGLE	ALONG	CD. / SQ. M.		(FOOTLAMBERTS)		ACROSS
		22.5	45	67.5		
0	3953 ( 1153)	3953 ( 1153)	3953 ( 1153)	3953 ( 1153)		3953 ( 1153)
30	3725 ( 1087)	3398 ( 991)	3101 ( 905)	2934 ( 856)		2844 ( 830)
40	3516 ( 1026)	3140 ( 916)	2754 ( 803)	2732 ( 797)		2727 ( 796)
45	3358 ( 980)	2940 ( 858)	2684 ( 783)	2673 ( 780)		2694 ( 786)
50	3142 ( 917)	2686 ( 783)	2531 ( 738)	2682 ( 782)		2671 ( 779)
55	2910 ( 849)	2479 ( 723)	2438 ( 711)	2637 ( 769)		2751 ( 803)
60	2684 ( 783)	2262 ( 660)	2370 ( 691)	2662 ( 777)		2731 ( 797)
65	2281 ( 665)	2034 ( 593)	2333 ( 681)	2552 ( 744)		2681 ( 782)
70	1873 ( 546)	1786 ( 521)	2242 ( 654)	2644 ( 771)		2841 ( 829)
75	1499 ( 437)	1587 ( 463)	2136 ( 623)	2839 ( 828)		3082 ( 899)
80	886 ( 258)	1375 ( 401)	2331 ( 680)	2890 ( 843)		3102 ( 905)
85	418 ( 122)	1017 ( 296)	2082 ( 607)	2754 ( 803)		2713 ( 792)

DETERMINED IN ACCORDANCE WITH CURRENT IES PUBLISHED PROCEDURES

LIGHTING SCIENCES CANADA LTD.  
440 PHILLIP ST., UNIT 19  
WATERLOO, ONTARIO

CERTIFIED TEST REPORT NO. LSC B505  
COMPUTED BY LSC PROGRAM \*\*TEST-LITE\*\*

BEGHELLI 4FT. LUMINAIRE CAT. NO. HZ100 4 HT D1 120V PC REFLECTOR  
WITH PC ALUMINIZED REFLECTOR AND CLEAR WRAP LENS  
ONE F32T8/TL841 32W T8 FLUORESCENT LAMP. LUMEN RATING = 2950 LMS.  
ONE SYLVANIA 120-277V 1 OR 2-LAMP ELECTRONIC BALLAST NO. QTP2x32T8/UNV ISN-SC

COEFFICIENTS OF UTILIZATION

ZONAL CAVITY METHOD

EFFECTIVE FLOOR CAVITY REFLECTANCE = .20

CC WALL	80				70				50				30				10				0
	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	.95	.95	.95	.95	.92	.92	.92	.92	.88	.88	.88	.83	.83	.83	.79	.79	.79	.77			
1	.86	.82	.78	.75	.84	.80	.77	.74	.76	.73	.71	.72	.70	.68	.69	.67	.65	.64			
2	.78	.72	.66	.61	.76	.70	.65	.60	.66	.62	.58	.63	.60	.57	.60	.57	.55	.53			
3	.71	.63	.56	.51	.69	.62	.56	.51	.59	.54	.49	.56	.52	.48	.54	.50	.47	.45			
4	.66	.56	.49	.44	.64	.55	.48	.43	.52	.47	.42	.50	.45	.41	.48	.44	.40	.39			
5	.60	.50	.42	.37	.58	.48	.42	.36	.46	.40	.36	.44	.39	.35	.43	.38	.34	.33			
6	.55	.44	.37	.32	.53	.43	.37	.32	.42	.36	.31	.40	.35	.31	.39	.34	.30	.28			
7	.51	.40	.33	.28	.49	.39	.32	.28	.38	.31	.27	.36	.31	.27	.35	.30	.26	.25			
8	.47	.36	.29	.24	.46	.35	.29	.24	.34	.28	.24	.33	.27	.23	.31	.27	.23	.21			
9	.43	.33	.26	.21	.42	.32	.25	.21	.31	.25	.21	.30	.24	.20	.28	.24	.20	.18			
10	.40	.30	.23	.19	.39	.29	.23	.19	.28	.22	.18	.27	.22	.18	.26	.21	.18	.16			

DETERMINED IN ACCORDANCE WITH CURRENT IES PUBLISHED PROCEDURES  
LUMINAIRE INPUT WATTS = 34.9  
LABORATORY RESULT MAY NOT BE REPRESENTATIVE OF FIELD PERFORMANCE.  
BALLAST FACTORS HAVE NOT BEEN APPLIED.